
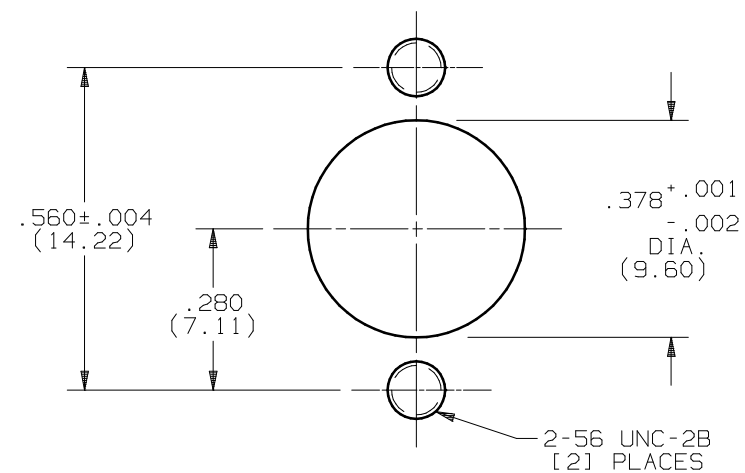
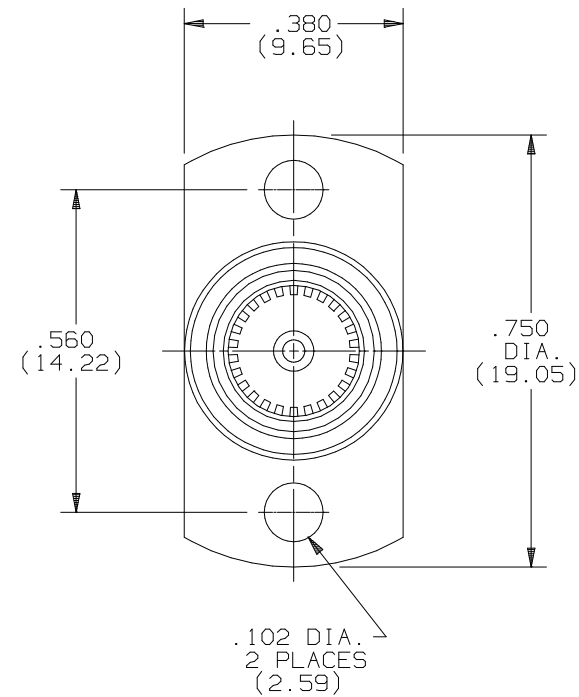


PRODUCT DATA DRAWING

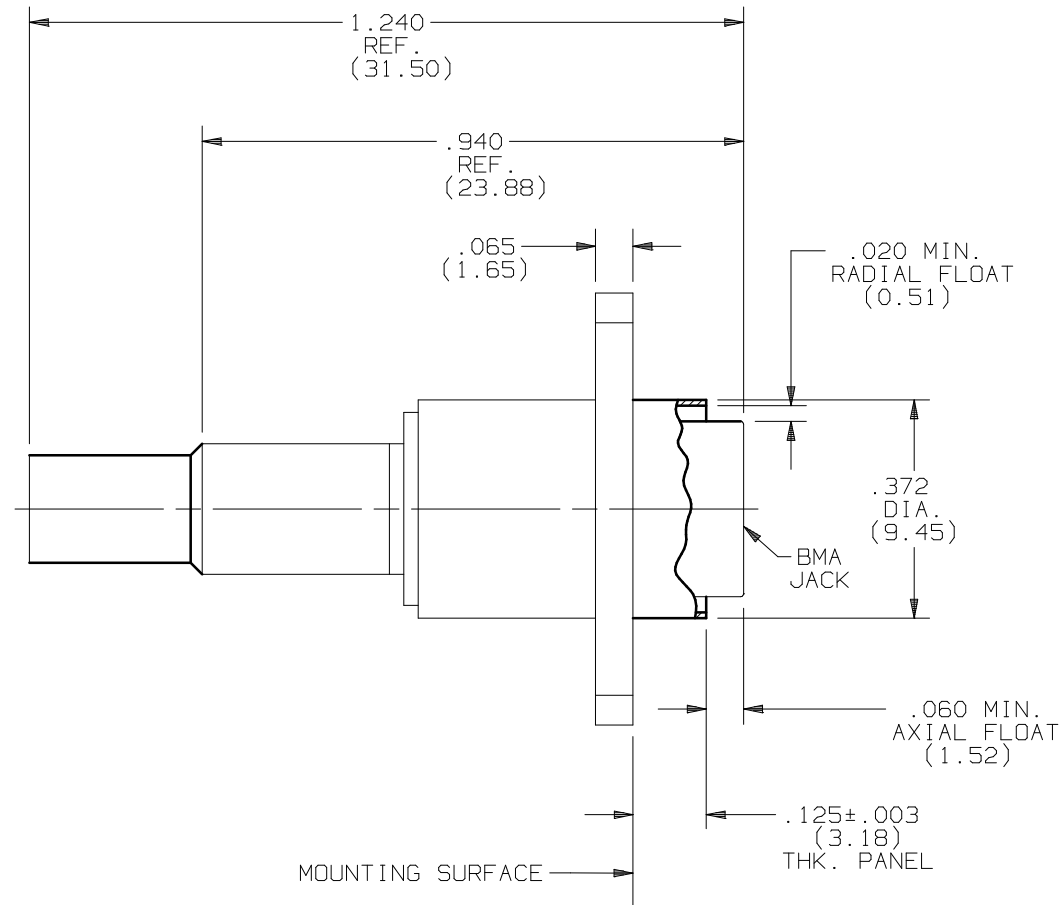

RECOMMENDED MOUNTING HOLE

MATERIAL:

BODIES,
INSERT: STAINLESS STEEL PER AMS-5640, UNS S30300, TYPE I

CONTACT,
CONTACT SLEEVE: BERYLLIUM COPPER PER ASTM-196,
COND. TD04, ALLOY UNS-C17300

CONTACT: BRASS PER ASTM-B-16, ALLOY UNS C36000, H02

SHIM SPRING,
OUTER CONTACT: BERYLLIUM COPPER PER ASTM-B-194,
COND. TD04, ALLOY UNS-C17200

INSULATOR: PTFE PER ASTM-D-1710

CRIMP RING: COPPER PER ASTM-B-88-88A, TYPE K, TEMPER H

LOCK RING: STAINLESS STEEL PER ASTM-A-240,
ALLOY UNS S30400, TYPE 304

COIL SPRING: 302 STAINLESS STEEL

SHRINK TUBING: POLYOLEFIN PER MIL-I-23053/4-102-0

FINISH:

BODIES,
INSERT,
LOCK RING,
COIL SPRING: PASSIVATE PER QQ-P-35 TYPE II

CONTACTS,
CONTACT SLEEVE,
SHIM SPRING,
OUTER CONTACT: GOLD PER MIL-G-45204, TYPE I,
GRADE C, CLASS 0 OVER NICKEL
PER QQ-N290 CLASS 2

CRIMP RING: NICKEL PER QQ-N-290, CLASS 2

PERFORMANCE:

IMPEDANCE: 50 OHMS
FREQ. RANGE: DC-12.4 GHZ
DWV: 750 VRMS
INSUL. RES.: 5000 MEGOHMS, MIN.

SYM.	DESCRIPTION	DATE	APPR.	UNLESS OTHERWISE SPECIFIED: 1)ALL DIMENSIONS ARE AFTER PLATING. 2)BREAK CORNERS & EDGES .005 R.MAX. 3)CHAM. 1st & LAST THDS. 4)SURFACE ROUGHNESS 63 / MIL-STD-10. 5)DIAS. ON COMMON CENTERS TO BE CONCENTRIC WITHIN .005 T.I.R. 6)REMOVE ALL BURRS.	DIMENSIONS ARE IN INCHES TOLERANCES: DECIMALS FRACTIONAL ANGULAR .X ±.030 X° ±1°0' .XX ±.015 ±1/64 X°X'±15' .XXX ±.005			
B	REV. DCN 25840	02/00	STW		MATERIAL:	SEE ABOVE	□" AREA:	SV Microwave, Inc. 2400 Centrepark West Drive, Suite 100 West Palm Beach, FL 33409 TITLE: BMA FLANGE MOUNT JACK FLOATING REAR MOUNT CRIMP FOR RG-316 DWG. NO. SF1738-6002
C	REV. DCN 29113	11/02	STW		FINISH:	SEE ABOVE	N/A	
				DRAWN:	VMJ	10/26/99		
				CHECKED:	STW	10/26/99		
				APPROVED:	STW	10/26/99		