

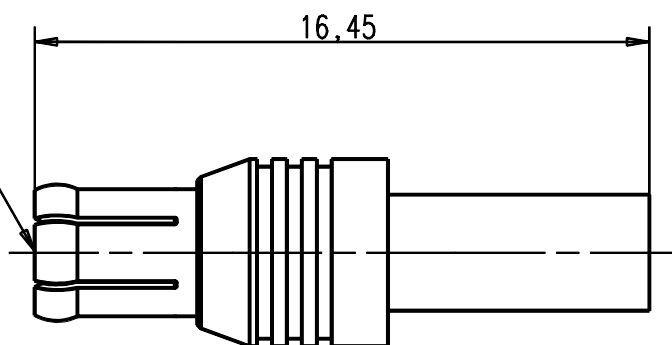


Steckbereich nach IEC 1169-36 Grad2
Mating area acc.to IEC 1169-36 Grade2

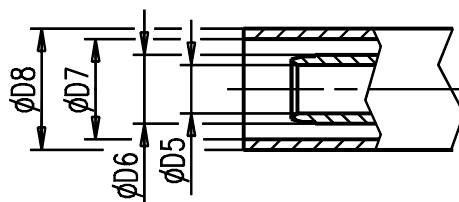

Kabelzuschnitt
Stripping dimension

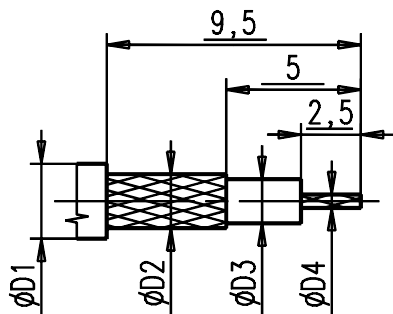

1) Steckkraft mit Buchse
Engagement force with jack
5-12 N

2) Abzugskraft mit Buchse
Separation force with jack
min. 10 N, max. 20 N

Fuer Kabel /
For cable

Gr.	Type Typ	ØD1 max.	ØD2 max.	ØD3 max.	ØD4 max.	ØD5	ØD6	ØD7	ØD8	Crimp Aussen/out	Crimp Innen/in
1	Enviroflex_178	1,84	1,35	0,82	0,305	1,15	1,70	2,25	3,20	2.67	0,70

IMS CONNECTOR
SYSTEMS

general tolerance
ISO 2768
mH

scale: 5:1

Assembly instruction:
Stripping dimension:

					date	name
					generate	22.02.05 Sarfert
					checked	
					Norm	
					44947	

Kabelstecker
Cable mount plug



3932.01.1310.01'

Rev.

nr.	rev.	alteration	date	name
-----	------	------------	------	------